


GREE DUCTFREE MINI-SPLITS OUTDOOR CONDENSING UNITS
WALL MOUNT CONFIGURATION AND ANCHOR SELECTION - WIND LOAD EXAMINATION

CODE: FMC and FBC 7th Ed. (2020) BLDG, ASCE 7-16
 MIAMI-DADE WIND SPEED = 195 MPH (Risk Cat. IV)
 For Heights <= 60 ft. (Wood stud walls only <= 20')

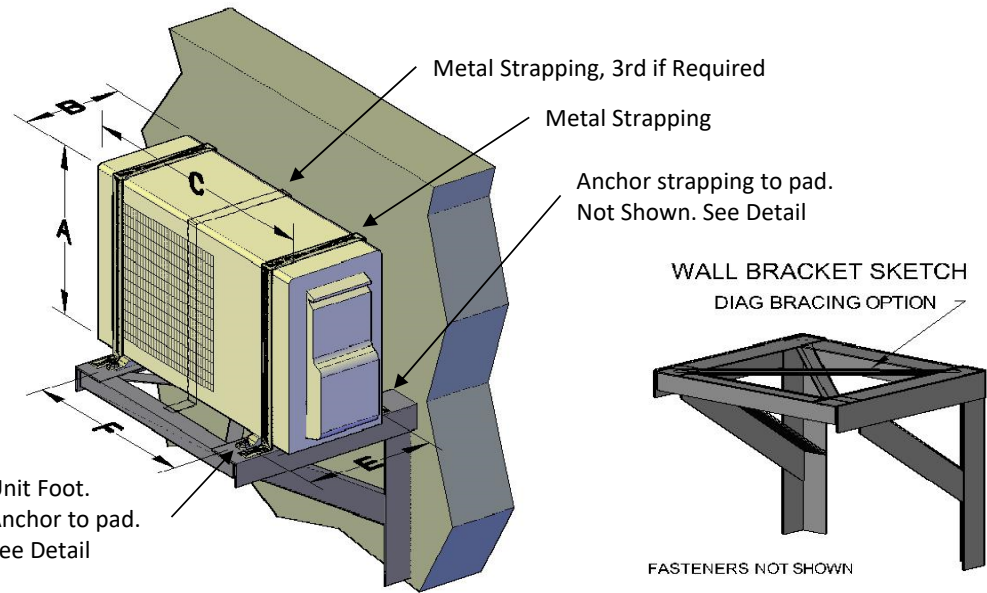

ENGINEERING CONFORMANCE ANALYSIS:
 THE TABLE SHOWS WALL MOUNT BRACKET AND ANCHOR TYPES FOR VARIOUS MODELS OF HVAC OUTDOOR EQUIPMENT UP TO 3 TONS THAT MEET THE FOLLOWING ANALYSIS: • OVERTURN • SLIDING • ANCHOR PULLOUT AND SHEAR STRENGTH • EQUIPMENT INTEGRITY.

TABLE A-2

| LIVO - Series | | Weight | Length C | Width B | Height | Mount | Mount |
|-----------------------|--|--------|----------|---------|---------|---------|---------|
| Model No. | | (lbs) | (in.) | (in.) | A (in.) | E (in.) | F (in.) |
| LIVS09HP115V1AO/BO | | 59 | 30.7 | 10.1 | 21.3 | 11.3 | 21.3 |
| LIVS12HP115V1AO/BO | | 64 | 30.7 | 10.1 | 21.3 | 11.3 | 21.3 |
| LIVS09HP230V1AO/BO | | 65 | 28.0 | 10.0 | 21.3 | 11.3 | 20.1 |
| LIVS12HP230V1AO/BO | | 69 | 28.0 | 10.0 | 21.3 | 11.3 | 20.1 |
| LIVS18HP230V1AO/BO | | 90 | 35.3 | 13.4 | 27.6 | 15.6 | 22.0 |
| LIVS24HP230V1AO/BO | | 104 | 35.3 | 13.4 | 27.6 | 15.6 | 22.0 |
| LIVS30HP230V1AO/BO/CO | | 152 | 36.2 | 14.6 | 31.1 | 15.5 | 26.4 |
| LIVS36HP230V1AO/BO/CO | | 161 | 36.2 | 14.6 | 31.1 | 15.5 | 26.4 |

| Unit Anchor | Installation Requirements | | | | | | Strapping | | Design Check: | |
|-------------|---------------------------|--------|--------|------|------|------|-------------------------|-----------------|------------------|-------------------|
| | T, in. | L, in. | U, in. | V, # | X, # | Y, # | # of Straps if Required | Gauge thickness | Unit Foot Anchor | Wall Anchor Check |
| A-4 | 27 | 21 | 16 | 2 | 2 | 2 | Yes, 2 | 22ga | 2.76 | 4.56 |
| A-4 | 27 | 21 | 16 | 2 | 2 | 2 | Yes, 2 | 22ga | 2.77 | 4.56 |
| A-4 | 26 | 21 | 16 | 2 | 2 | 2 | Yes, 2 | 22ga | 3.03 | 4.38 |
| A-4 | 26 | 21 | 16 | 2 | 2 | 2 | Yes, 2 | 22ga | 3.03 | 4.38 |
| A-4 | 27 | 24 | 16 | 3 | 2 | 2 | Yes, 2 | 22ga | 1.89 | 4.88 |
| A-4 | 27 | 24 | 16 | 3 | 2 | 2 | Yes, 2 | 22ga | 1.90 | 4.94 |
| A-4 | 32 | 26 | 16 | 3 | 2 | 2 | Yes, 2 | 22ga | 1.56 | 5.94 |
| A-4 | 32 | 26 | 16 | 3 | 2 | 2 | Yes, 2 | 22ga | 1.56 | 6.00 |

Bri-Ko Engineering, Inc.,
 Structural Analysis
 Calc Sht: EC-1
 Description: Mechanical Equipment on Wall Mount Bracket Calc
 Spreadsheet designed by: B. Schwartz, PE
 Date data input: 25-Mar-21

Code: FBC 7th Ed. (2020) and ASCE 7-16.
Design Methodology and Load Combinations:
 Design Method: LRFD $\Phi = 0.90$
 Load Combos: FBC Eqn. 16-6 0.9 D + 1.0 W
Wind Forces: Based on ASCE 7-16, 30.3, Fig 30.3-1, C&C Walls < 60ft.
 Ultimate Design Wind Speed, Vult (3-sec gust): **195 mph** Miami Dade
 Nominal Design Wind Speed, Vasd: **151 mph**
 Risk Category: **IV** Dir., Topo., Gust Effect: **0.85** **1.00** **N/A**
 Height, h: **60 ft** Exp. Cat.: **C** Vel. Pres. Exp Coef., Kz: **1.137**
 Enclosure Cat. **N/A** $G_{cp} = 0$
Velocity Pressure $q_h = 0.00256 K_z K_{zt} K_d V^2$ (lb/ft²) $q_h =$ **94.0 psf**
 $p = q_h(GC_p - GC_{pi})$ ($GC_p = 1.0$ ver., 1.4 lat.) Fver, Flat: **94.0 psf**, **131.7 psf**

Limit States: for illustration purposes only:
 Select UnitType: **LIVO** Select Model # **LIVS36HP230V1AO/BO/CO**
 Number of Vert Brkts is 2 Total number of anchors is 6

Loads, (lbs): P1= 1029 P2= 345 P3= 415 PD= 161

Resistance to shear -unit feet:
 Reqd. Shear/leg = **277 lbs** Nominal Shear per leg: **900 lbs** CHECKS OK

Resistance to tension -unit feet:
 Reqd. Sher/anc: **566 lbs** Nom Shear per bolt: **1700 lbs** CHECKS OK

Resistance to Moment and Uplift: Use Load Combo: **0.90 D + 1.00 W**
 Overturn M at brkt bottom: **42.7 k-in** for concrete and block at max 60' ht.
 Concrete Wall: Nom Mom resist from all anchors: **67.7 k-in** CHECKS OK
 Block Wall: Nom Mom resist from all anchors: **49.5 k-in** CHECKS OK

Overturn M at brkt bottom: **33.9 k-in** for wood at max 20' ht.
 Wood Wall: Nom Mom resist from all anchors: **45.5 k-in** CHECKS OK

Unit Integrity: If Required. Only if manufacturer does not state design wind pressure.
 Required tension on strap= **598 lbs**
 Strap width, gauge= **1.375 in.** **22ga** min gauge thickness
 Steel Strength= **45 ksi min.** Strength of strap= **817 lbs** Checks OK

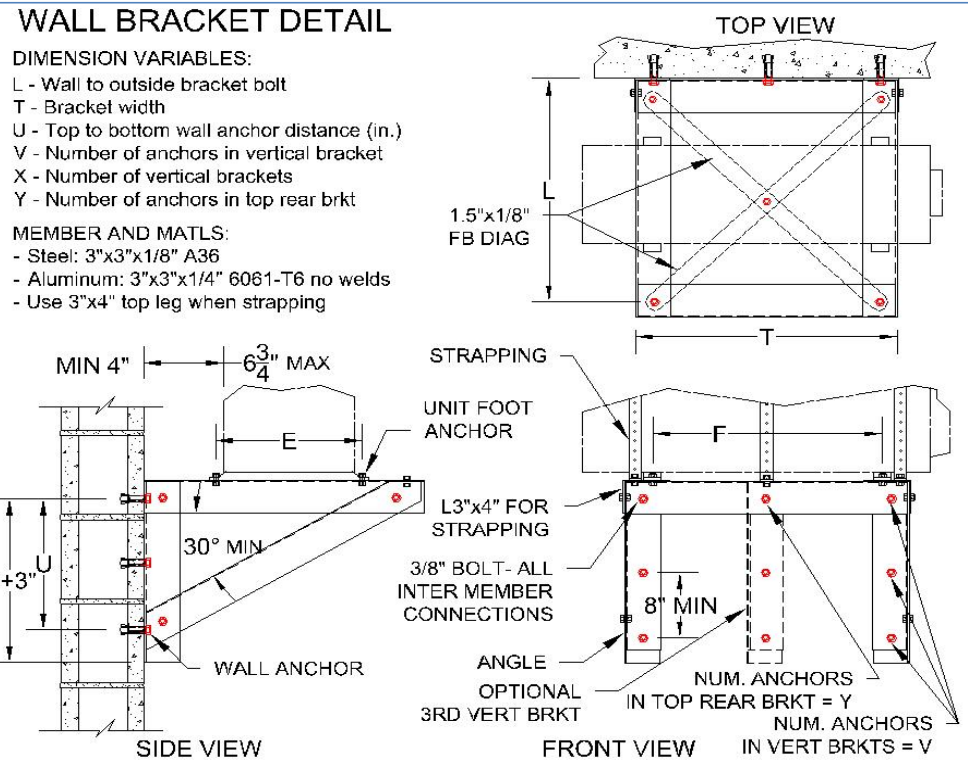
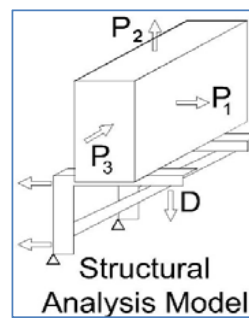


TABLE A-1 ANCHOR TYPE AND ALLOWABLE STRENGTHS (LRFD)

| SYM | ANCHOR DESCRIPTION & MANUFACTURER | EMBED | STRENGTH AT MIN SPACING | |
|------|-----------------------------------|--------|-------------------------|-------------|
| | | | PULL OUT (LBS) | SHEAR (LBS) |
| C-1 | 3/8" WEDGE BOLT (Powers) | 2-1/2" | 1025 | 1370 |
| BG-1 | 3/8" WEDGE BOLT | 3-1/2" | 750 | 755 |
| W-1 | 3/8" LAG SCREW | 2-1/2" | 690 | 320 |
| A-4 | 1/4" A307 Bolt | N/A | 1700 | 900 |
| A-5 | 5/16" A307 Bolt | N/A | 2500 | 1500 |

Anchor Notes: 1. Strengths for lag screws in wood are from NDS for wood construction 2005 for Southern Pine, Cd= 1.6, Cm= 1.0, Ceg= 1.0, Ct= 1.0, main member tm= 3.5", side member ts= 14 ga mtl. Strengths for other anchors are from manufacturer's specs with min. safety factor of 4. 2. Poured concrete wall with minimum f'c= 3000 psi. 3. BG-1 -Blocks (CMU) are medium weight and grout filled. One anchor per cell maximum. 4. Wood stud is minimum nominal 2"x4" with anchor centered in stud. 5. IMPORTANT: For Structure Type of Wood, Roof heights are limited to 20 ft maximum for all models.

GENERAL NOTES:
 1. THE ANALYSIS CONFORMS TO THE REQUIREMENTS OF THE FBC 7TH ED. (HIGH VELOCITY HURRICANE ZONE) AND ASCE 7-16 DESIGN WIND LOADS - OTHER STRUCTURES SECTION 29.4.2. NOTE: WIND FORCES ARE CONSIDERED AS MOST CLOSELY CONFORMING TO THE PRESSURES FOR SOLID ATTACHED SIGNS AND ARE DESIGNATED AS PER FIG.30.4-1 IN COMPONENTS AND CLADDING.
 2. THE AC UNIT IS MOUNTED ON A BRACKET ON THE OUTSIDE OF A CONCRETE, BLOCK OR WOOD STUD WALL.
 3. ANCHORS USED TO FASTEN THE UNIT TO THE WALL BRACKET ARE A307 OR HIGHER STRENGTH STEEL BOLTS. ANCHORS USED TO FASTEN THE WALL BRACKET TO WALL AS INDICATED IN THE TABLE A-2 ANCHORS DETAILS.
 4. WALL BRACKET MEMBERS ARE EITHER STEEL BOLTED OR WELDED OR ALUMINUM BOLTED ONLY AS INDICATED IN THE DETAIL.
 5. CLEARANCES: FASTENERS IN BRACKET METAL MUST HAVE EDGE CLEARANCES OF 1-1/2 DIAMETERS. ANCHORS IN CONC BLOCK MUST BE AT LEAST 12" FROM THE EDGE OF THE WALL.
 6. UNIT INTEGRITY, IF NOT DESIGNATED BY THE MANUFACTURER FOR THE STATED WIND PRESSURES, IS ADDRESSED BY STRAPPING ATTACHED TO THE UNIT AND ANCHORED TO THE SUPPORT ANGLES. THIS RESISTS SHELL AND FRAME SEPARATION.

Bracket design parameters:
 Distance from wall to unit: -----> 6 in.
 Distance from bottom anchor to bottom of vertical bracket: -----> 3 in.
 Distance from foot anchor to outside of bracket width: -----> 2.5 in.
 Outside bracket angle width: --> 3 in.

