




## SUBMITTAL DATA

FXE24HP230V1R32AH / FXE30HP230V1R32AO  
24000 BTU/H Unitary Heat Pump Split System

Job Name	Location	Date
Purchaser	Engineer	
Submitted to	For	
Unit Designation	Schedule No.	

 <p>FXE24HP230V1R32AH</p>	 <p>FXE30HP230V1R32AO</p>	 <p>WK-010WC1</p>
--	---	--

### GENERAL FEATURES


- AHRI Certificate: 216626007
- High Efficiency DC Inverter Technology
- Zero Lot Line Design
- Operation Range: 5°F ~ 118°F
- New R32 Refrigerant
- WK-010WC1 Programmable Wired Controller Included
- Multi-Position Air Handler
- RS485 Communication and Universal 24V Control
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

**SPECIFICATIONS, FEATURES & FUNCTION SUMMARY**

SPECIFICATIONS		FXE24HP230V1R32AH / FXE30HP230V1R32AO	
System Type		HEAT PUMP	
<b>SYSTEM PERFORMANCE</b>			
Cooling Capacity	Min - Max	Btu/h	12,000 - 26,400
	Rated Capacity @95°F	Btu/h	24,000
Heating Capacity	Min - Max	Btu/h	12,000 - 27,000
	Rated Capacity @47°F	Btu/h	24,000
	Rated Capacity @17°F	Btu/h	19,600
	Rated Capacity @5°F	Btu/h	19,000
SEER2			18.5
EER2			11.7
HSPF2			8.3
COP @5°F			1.75
Cooling Temperature Range	°F	5 - 118	
Heating Temperature Range	°F	5 - 75	
Refrigerant Type	R32		
<b>INDOOR UNIT</b>		<b>FXE24HP230V1R32AH</b>	
Power Supply	VAC	208-230V / 1Ph / 60 Hz	
Sound Pressure Level	dB(A)	47	
Control Voltage	VAC	24	
MOCP	A	15	
MCA	A	4.7	
Electric Heater (Optional)	kW	5, 6, 10	
Air Flow	CFM	760	
External Static Pressure (Up to)	In W.c.	1.0	
Dehumidification	pt/hr	4.25	
Drain Piping	in	Φ1×0.05	
External Dimensions (W x D x H)	in	18-1/8 × 21-1/4 × 43-1/2	
Package Dimension (L x W x H)	in	20-5/8 × 26 × 45-5/8	
Net Weight	lbs	135.6	
Gross Weight	lbs	144.4	
<b>OUTDOOR UNIT</b>		<b>FXE30HP230V1R32AO</b>	
Power Supply	VAC	208-230V / 1Ph / 60 Hz	
Sound Pressure Level	dB(A)	58	
Control Voltage	VAC	24	
Rated Current Cooling	A	17.5	
Rated Current Heating	A	11.5	
MOCP	A	25	
MCA	A	21.6	
Compressor Type	GREE G20 / Double Cylinder / 1 - Stage Inverter		
External Dimensions (W x D x H)	in	36-1/4×14-9/16×29-3/8	
Package Dimension (L x W x H)	in	42-1/2 × 19 × 31-1/2	
Net Weight	lbs	113.5	
Gross Weight	lbs	122.4	
Refrigerant Charge - R32	oz	67.0	
Additional Charge	oz/ft	0.215	
<b>REFRIGERANT PIPING</b>			
Line Set Size (Liquid - Gas) - Flared Connections	in	3/8 - 3/4	
Pre-Charge Length	ft	31	
Pipe Length (Min - Max)	ft	10 - 98	
Max. Pipe Elevation	ft	49	

FEATURES & FUNCTIONS SUMMARY	FXE24HP230V1R32AH / FXE30HP230V1R32AO
Compressor	Inverter
Ultra Low Frequency Torque Control	Yes
Power Factor Correction	Yes
Compressor Type	Rotary
Electronic Expansion Valve (EEV)	Yes
Basepan With Electric Heater	Yes
Compressor With Electric Heater	Yes
Fin Coating (Outdoor - Golden & Indoor - Blue)	Acrylic Resin
Intelligent Defrosting	Yes
Intelligent Preheating	Yes
Low Voltage Startup	Yes
Memory/Power Failure Recovery	Yes
Self Diagnosis	Yes
Low Ambient Cooling	No
24VAC Thermostat Compatible	Yes
Indoor Fan Type	Centrifugal
Multi Fan Speeds	5
Auxiliary Electrical Heater	Optional
A2L Leak Detection Sensor (Indoor)	Factory Installed

**FAN PERFORMANCE**

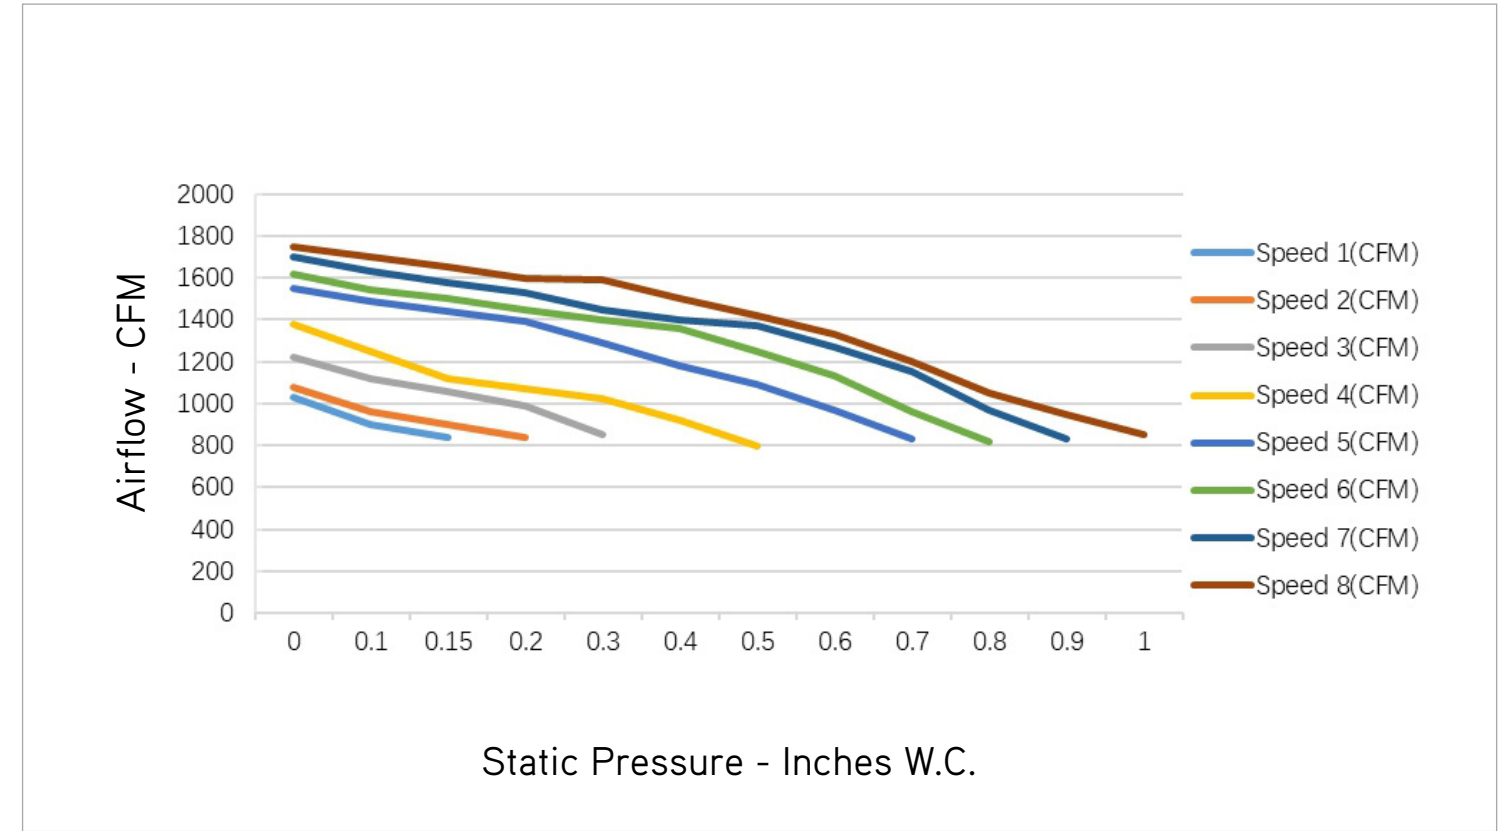


**NOTE:**  
 1. Above chart CFM ratings are based on dry coil with factory filter installed.  
 2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

## DIMENSIONS

### INDOOR UNIT

Unit: inch


FXE24HP230V1R32AH	
DIMENSIONS	
A	11-5/8
B	16-3/4
H	43-1/2
W	18-1/8
D	21-1/4

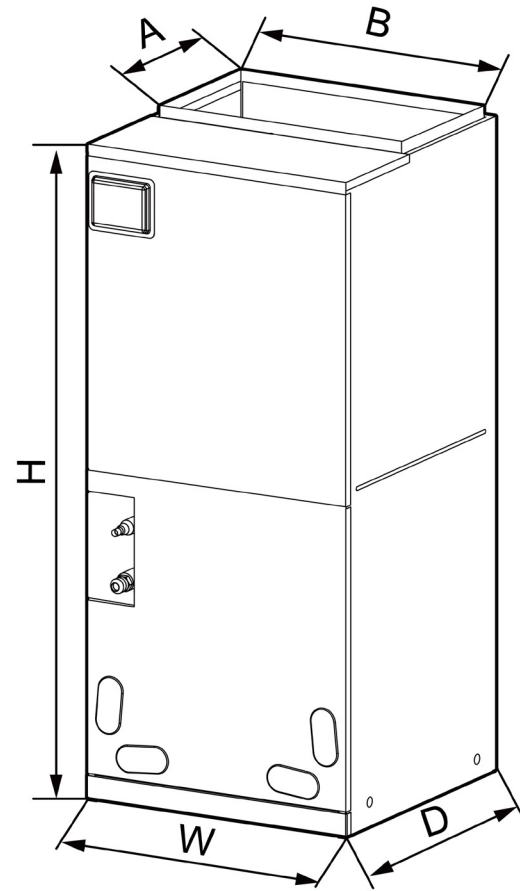


### OUTDOOR UNIT

Unit: inch

FXE30HP230V1R32AO	
DIMENSIONS	
A	39-3/8
B	16-13/16
C	29-3/8
D	24
E	15-9/16
F	36-1/4
G	14-9/16

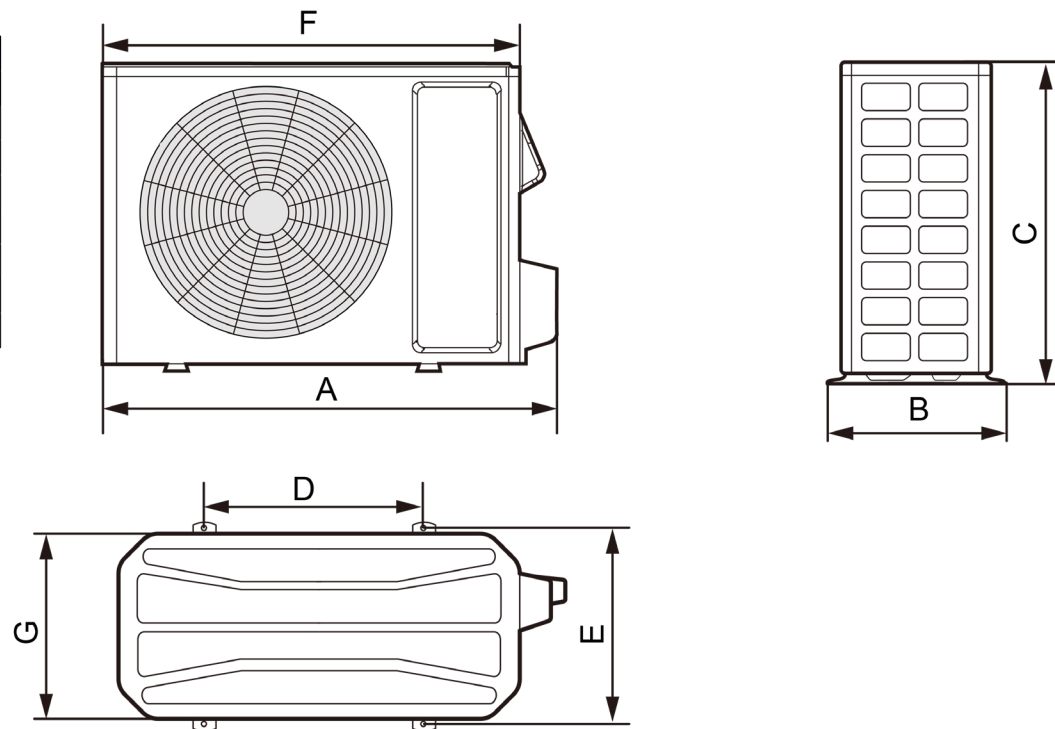

## ACCESSORY HEATER AND GENERAL INFORMATION

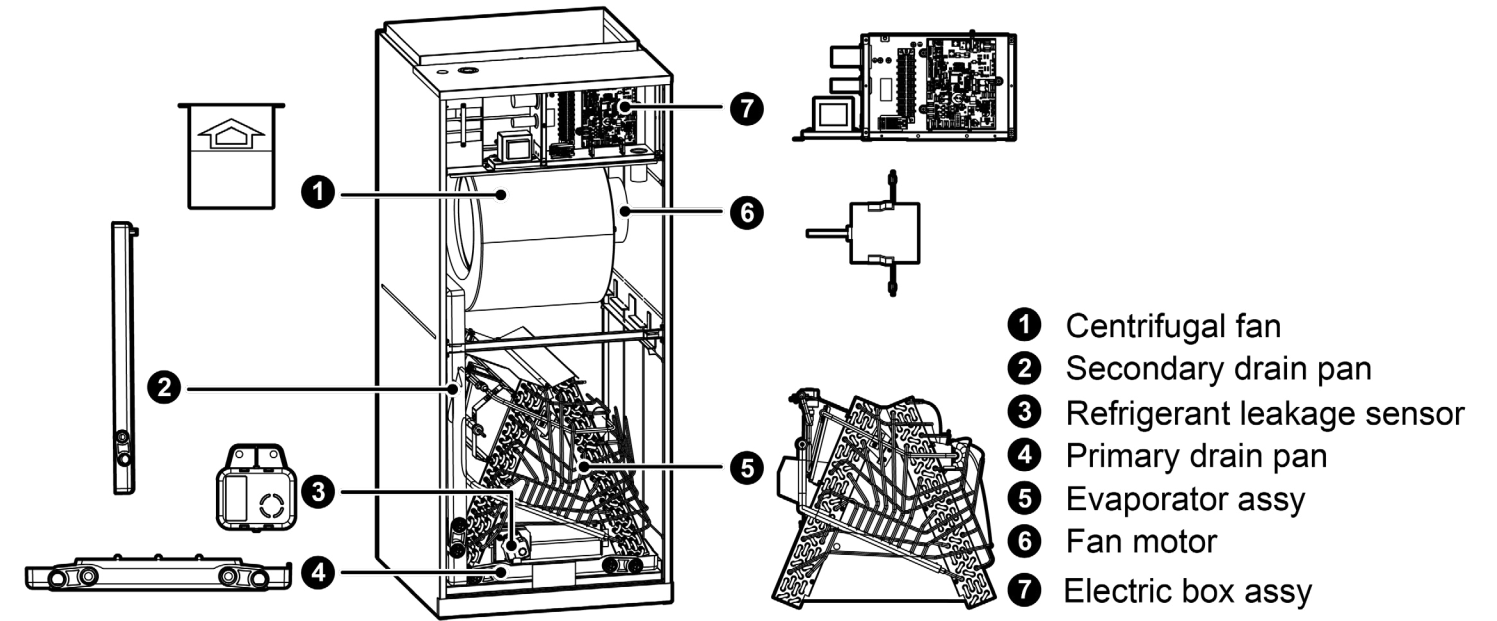

MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)	
			208V	230V	208V	230V	208V	230V
FXE24HP230V1R32AH	320004060249	FLEXA2LHTR05KWD	3.74	4.6	28	29.9	30	35
	320004060250	FLEXA2LHTR10KWD	7.49	9.2	50	55	60	60


MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)	
			208V	230V	208V	230V	208V	230V
FXE24HP230V1R32AH	320004060223	FLEXA2LHTR06	4.5	5.5	32	34.5	35	35

## CLEARANCES

### INDOOR UNIT

Minimum clearance

FRONT	> 24
-------	------

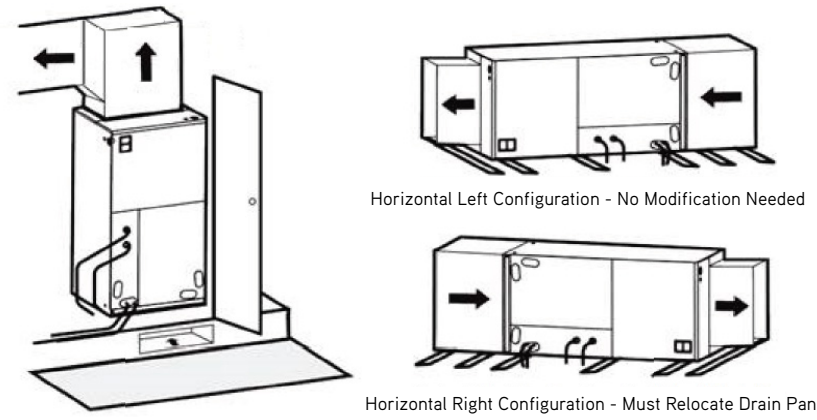

#### NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

### OUTDOOR UNIT


Minimum clearance

#### NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	$H_b, H_d, H$		(in)				
			a	b	c	d	e
B	-	-	-	$\geq 4$	-	-	-
A, B, C	-	-	$\geq 12$	$\geq 4$	$\geq 4$	-	-
B, E	-	-	-	$\geq 4$	-	-	$\geq 40$
A, B, C, E	-	-	$\geq 12$	$\geq 6$	$\geq 6$	-	$\geq 40$
D	-	-	-	-	-	$\geq 40$	-
D, E	-	-	-	-	-	$\geq 40$	$\geq 40$
B, D	$H_b < H_d$	$H_d < H$	-	$\geq 4$	-	$\geq 40$	-
	$H_b > H_d$	$H_d > H$	-	$\geq 4$	-	$\geq 40$	-
B, D, E	$H_b < H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 80$	$\geq 40$
		$1/2H < H_d \leq H$	-	$\geq 10$	-	$\geq 80$	$\geq 40$
	$H_b > H$	Prohibited					
	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 4$	-	$\geq 80$	$\geq 40$
$1/2H < H_d \leq H$		-	$\geq 8$	-	$\geq 80$	$\geq 40$	
	$H_d > H$	Prohibited					

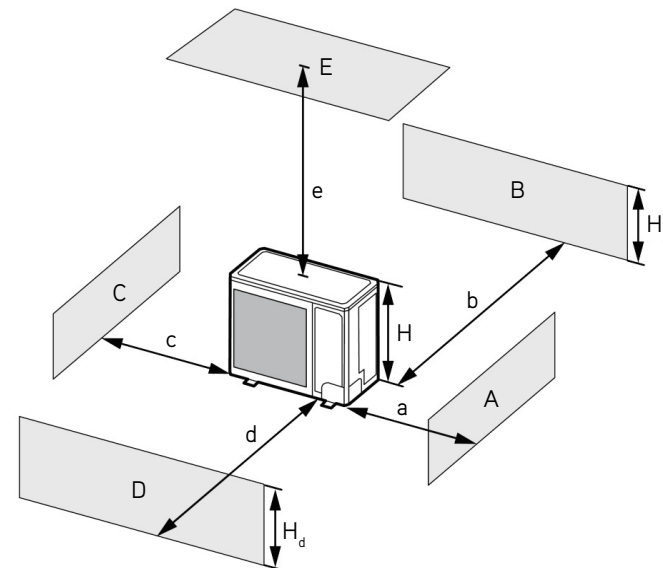

## CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	$H_b, H_d, H$		(in)				
			a	b	c	d	e
A, B, C	-	-	$\geq 12$	$\geq 12$	$\geq 40$	-	-
A, B, C, E	-	-	$\geq 12$	$\geq 12$	$\geq 40$	-	$\geq 40$
D	-	-	-	-	-	$\geq 80$	-
D, E	-	-	-	-	-	$\geq 80$	$\geq 40$
B, D	$H_b < H_d$	$H_d > H$	-	$\geq 12$	-	$\geq 80$	-
	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 80$	-
		$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 100$	
B, D, E	$H_b < H_d$	$H_d \leq 1/2H$	-	$\geq 12$	-	$\geq 80$	$\geq 40$
		$1/2H < H_d \leq H$	-	$\geq 12$	-	$\geq 100$	$\geq 40$
	$H_b > H$	Prohibited					
	$H_b > H_d$	$H_d \leq 1/2H$	-	$\geq 10$	-	$\geq 100$	$\geq 40$
$1/2H < H_d \leq H$		-	$\geq 12$	-	$\geq 100$	$\geq 40$	
	$H_d > H$	Prohibited					

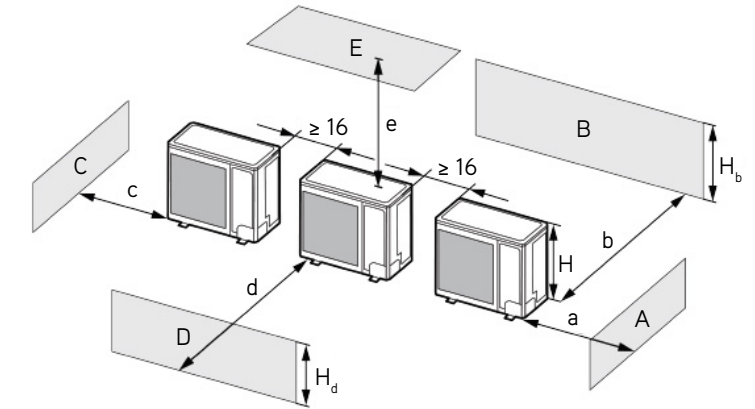

3. When outdoor units are installed in rows.

$H_b, H_d$	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H_d$	Prohibited

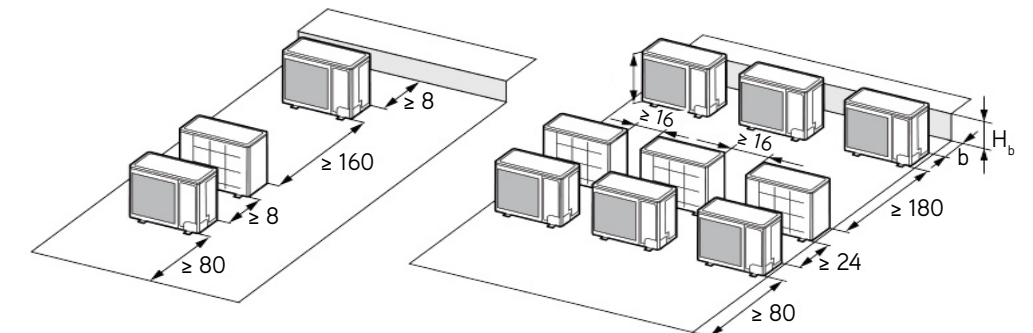

4. When outdoor units are installed one above another.

