




SUBMITTAL DATA

FXE36HP230V1R32AH / FXE36HP230V1R32AO
36000 BTU/H Unitary Heat Pump Split System

Job Name	Location	Date
Purchaser	Engineer	
Submitted to	For	
Unit Designation	Schedule No.	

 <p>FXE36HP230V1R32AH</p>	 <p>FXE36HP230V1R32AO</p>	 <p>WK-010WC1</p>
--	---	--


GENERAL FEATURES

- AHRI Certificate: 216626009
- High Efficiency DC Inverter Technology
- Zero Lot Line Design
- Operation Range: 5°F ~ 118°F
- New R32 Refrigerant
- WK-010WC1 Programmable Wired Controller Included
- Multi-Position Air Handler
- RS485 Communication and Universal 24V Control
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

SPECIFICATIONS, FEATURES & FUNCTION SUMMARY

SPECIFICATIONS		FXE36HP230V1R32AH / FXE36HP230V1R32AO		FEATURES & FUNCTIONS SUMMARY		FXE36HP230V1R32AH / FXE36HP230V1R32AO	
System Type		HEAT PUMP		Compressor		Inverter	
SYSTEM PERFORMANCE				Ultra Low Frequency Torque Control			
Cooling Capacity	Min - Max	Btu/h	17,000 - 37,400	Power Factor Correction			
	Rated Capacity @95°F	Btu/h	34,000	Compressor Type			
Heating Capacity	Min - Max	Btu/h	17,000 - 38,000	Electronic Expansion Valve (EEV)			
	Rated Capacity @47°F	Btu/h	34,000	Basepan With Electric Heater			
	Rated Capacity @17°F	Btu/h	27,400	Compressor With Electric Heater			
	Rated Capacity @5°F	Btu/h	21,600	Fin Coating (Outdoor - Golden & Indoor - Blue)			
SEER2		19.0		Intelligent Defrosting		Yes	
EER2		11.7		Intelligent Preheating		Yes	
HSPF2		8.3		Low Voltage Startup		Yes	
COP @5°F		2.0		Memory/Power Failure Recovery		Yes	
Cooling Temperature Range	°F	5 - 118		Self Diagnosis		Yes	
Heating Temperature Range	°F	5 - 75		Low Ambient Cooling		No	
Refrigerant Type		R32		24VAC Thermostat Compatible		Yes	
INDOOR UNIT				FXE36HP230V1R32AH			
Power Supply	VAC	208-230V / 1Ph / 60 Hz		Indoor Fan Type		Centrifugal	
Sound Pressure Level	dB(A)	51		Multi Fan Speeds		5	
Control Voltage	VAC	24		Auxiliary Electrical Heater		Optional	
MOCP	A	15		A2L Leak Detection Sensor (Indoor)		Factory Installed	
MCA	A	5.3					
Electric Heater (Optional)	kW	5, 6, 9, 10, 12, 15					
Air Flow	CFM	1000					
External Static Pressure (Up to)	In W.c.	1.0					
Dehumidification	pt/hr	6.02					
Drain Piping	in	Φ1×0.05					
External Dimensions (W x D x H)	in	21-1/4 × 21-1/4 × 48-3/16					
Package Dimension (L x W x H)	in	23-3/4 × 26 × 50-3/8					
Net Weight	lbs	163.1					
Gross Weight	lbs	178.6					
OUTDOOR UNIT				FXE36HP230V1R32AO			
Power Supply	VAC	208-230V / 1Ph / 60 Hz					
Sound Pressure Level	dB(A)	60					
Control Voltage	VAC	24					
Rated Current Cooling	A	17.5					
Rated Current Heating	A	11.5					
MOCP	A	25					
MCA	A	21.6					
Compressor Type		GREE G20 / Double Cylinder / 1 - Stage Inverter					
External Dimensions (W x D x H)	in	36-1/4×14-9/16×29-3/8					
Package Dimension (L x W x H)	in	42-1/2 × 19 × 31-1/2					
Net Weight	lbs	124.6					
Gross Weight	lbs	133.4					
Refrigerant Charge - R32	oz	98.8					
Additional Charge	oz/ft	0.215					
REFRIGERANT PIPING							
Line Set Size (Liquid - Gas) - Flared Connections	in	3/8 - 3/4					
Pre-Charge Length	ft	31					
Pipe Length (Min - Max)	ft	10 - 98					
Max. Pipe Elevation	ft	49					

FAN PERFORMANCE

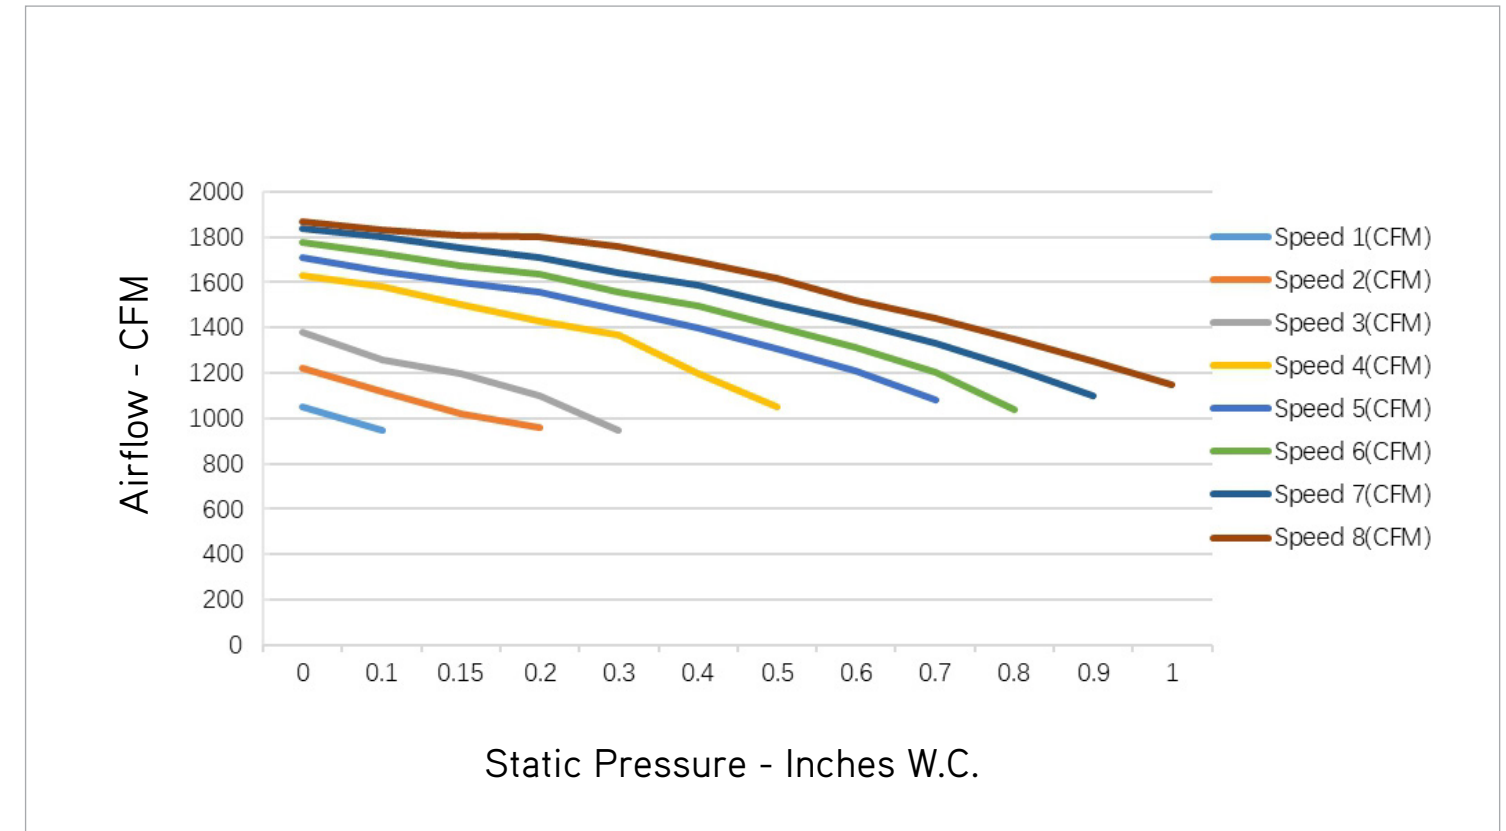


NOTE:
 1. Above chart CFM ratings are based on dry coil with factory filter installed.
 2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS

INDOOR UNIT

Unit: inch


FXE36HP230V1R32AH	
DIMENSIONS	
A	11-5/8
B	20
H	48-3/16
W	21-1/4
D	21-1/4

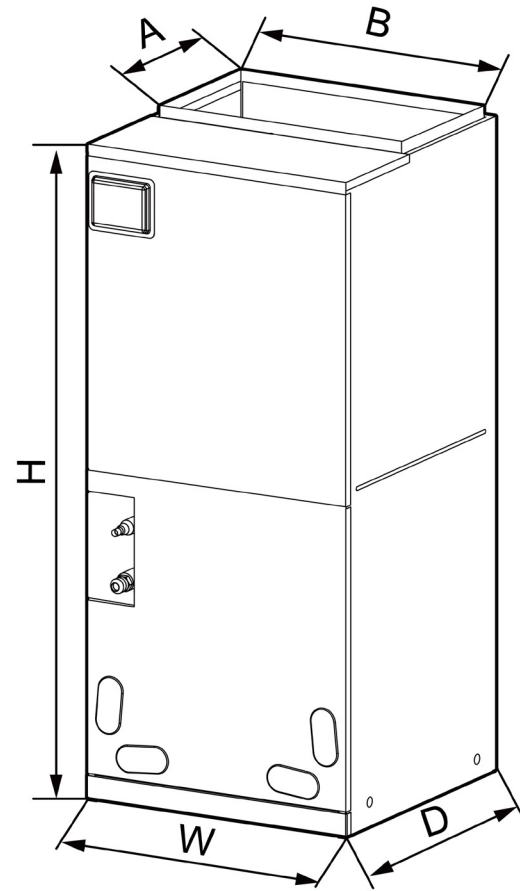


OUTDOOR UNIT

Unit: inch

FXE36HP230V1R32AO	
DIMENSIONS	
A	39-3/8
B	16-13/16
C	29-3/8
D	24
E	15-9/16
F	36-1/4
G	14-9/16

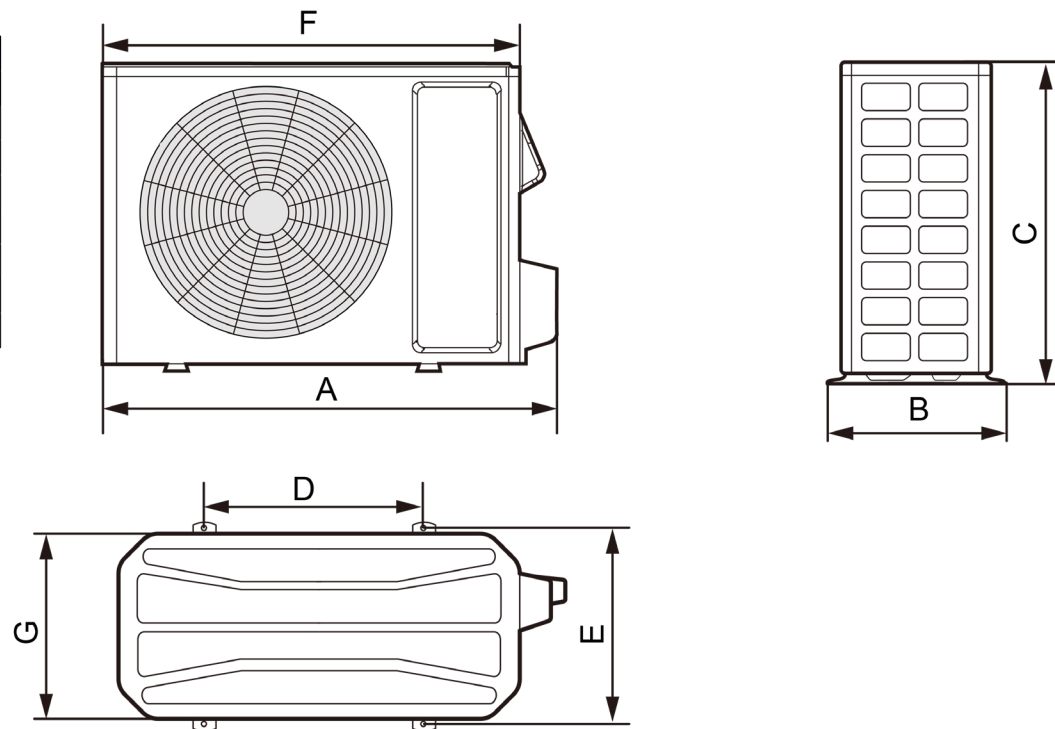

ACCESSORY HEATER AND GENERAL INFORMATION

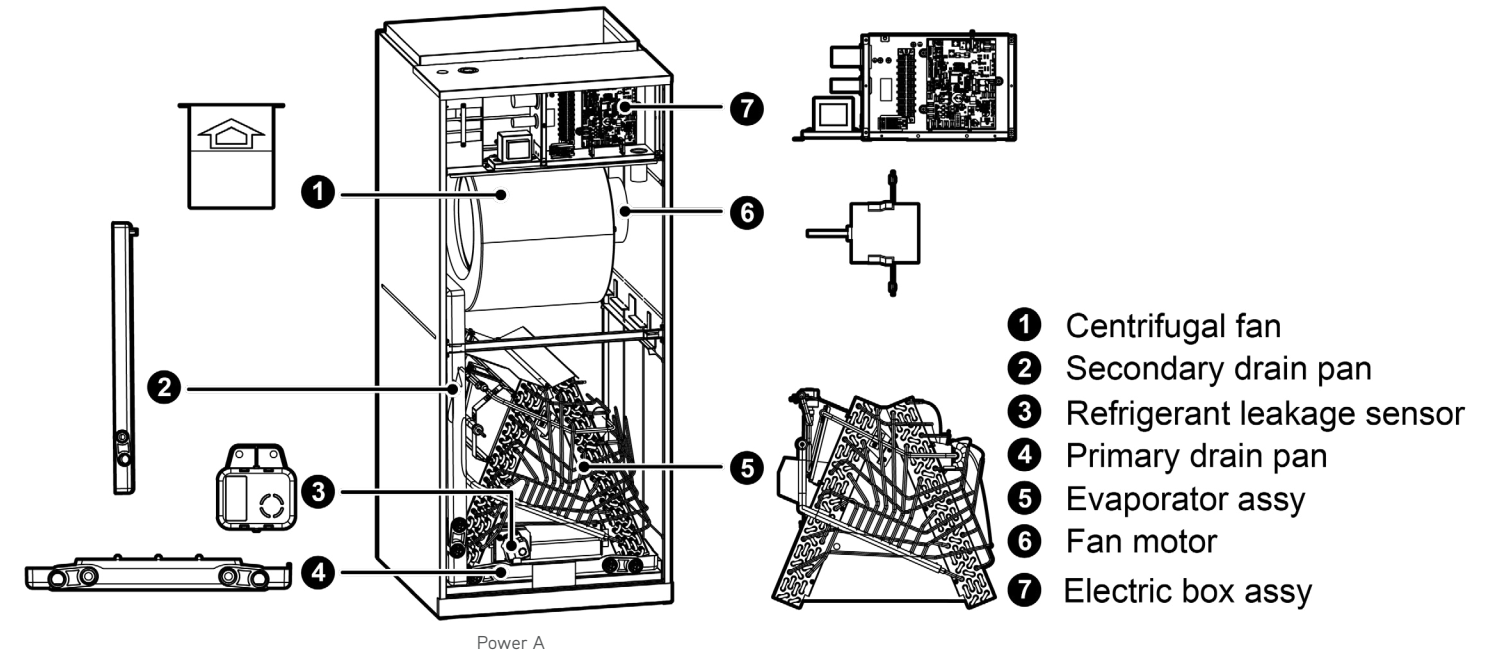

MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)	
			208V	230V	208V	230V	208V	230V
FXE36HP230V1R32AH	320004060249	FLEXA2LHTR05KWD	3.74	4.6	28	29.9	30	35
	320004060250	FLEXA2LHTR10KWD	7.49	9.2	50	55	60	60
	320004060251	FLEXA2LHTR15KWD	11.23	13.8	74	82	80	90


MODEL	Heat Kit Model	Part Number	Electric Heat (kW)		Min. Circuit Ampacity (A)		Max Fuse or Breaker (A)					
			208V	230V	208V	230V	208V	230V	208V	230V		
FXE36HP230V1R32AH	One Mains Supply											
	320004060223	FLEXA2LHTR06	3.74	4.6	31	33	35	35				
	Two Mains Supply											
						Power A	Power B	Power A	Power B	Power A	Power B	
	320004060224	FLEXA2LHTR09	6.03	7.36	32.7	13.8	35.2	15	35	15	40	20
	320004060225	FLEXA2LHTR12	7.49	9.2	32.7	27.5	35.2	30	35	30	40	35

CLEARANCES

INDOOR UNIT

Minimum clearance

FRONT	> 24
-------	------

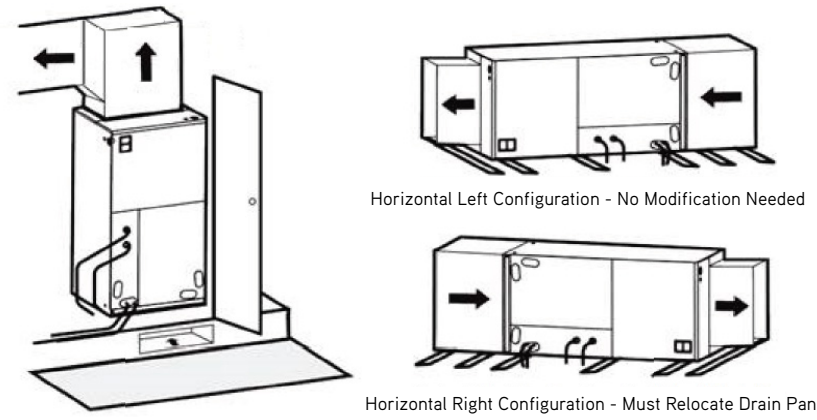

NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

OUTDOOR UNIT


Minimum clearance

NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


A - E	H_b, H_d, H		(in)					
			a	b	c	d	e	
B	-	-	-	≥ 4	-	-	-	
A, B, C	-	-	≥ 12	≥ 4	≥ 4	-	-	
B, E	-	-	-	≥ 4	-	-	≥ 40	
A, B, C, E	-	-	≥ 12	≥ 6	≥ 6	-	≥ 40	
D	-	-	-	-	-	≥ 40	-	
D, E	-	-	-	-	-	≥ 40	≥ 40	
B, D	$H_b < H_d$	$H_d < H$	-	≥ 4	-	≥ 40	-	
	$H_b > H_d$	$H_d > H$	-	≥ 4	-	≥ 40	-	
B, D, E	$H_b < H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 80	≥ 40	
		$1/2H < H_d \leq H$	-	≥ 10	-	≥ 80	≥ 40	
	$H_b > H$	Prohibited						
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 4	-	≥ 80	≥ 40	
$1/2H < H_d \leq H$		-	≥ 8	-	≥ 80	≥ 40		
		$H_d > H$	Prohibited					

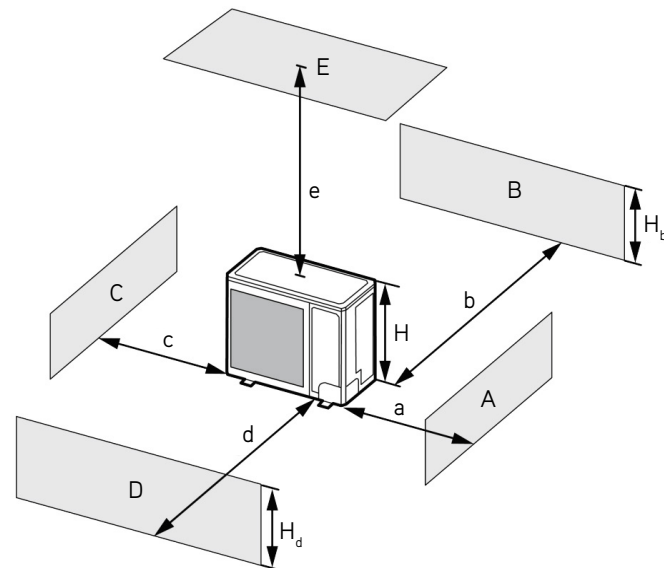

CLEARANCES


2. When two or more outdoor units are to be installed side by side.

A - E	H_b, H_d, H		(in)					
			a	b	c	d	e	
A, B, C	-	-	≥ 12	≥ 12	≥ 40	-	-	
A, B, C, E	-	-	≥ 12	≥ 12	≥ 40	-	≥ 40	
D	-	-	-	-	-	≥ 80	-	
D, E	-	-	-	-	-	≥ 80	≥ 40	
B, D	$H_b < H_d$	$H_d > H$	-	≥ 12	-	≥ 80	-	
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 80	-	
		$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100		
B, D, E	$H_b < H_d$	$H_d \leq 1/2H$	-	≥ 12	-	≥ 80	≥ 40	
		$1/2H < H_d \leq H$	-	≥ 12	-	≥ 100	≥ 40	
	$H_b > H$	Prohibited						
	$H_b > H_d$	$H_d \leq 1/2H$	-	≥ 10	-	≥ 100	≥ 40	
$1/2H < H_d \leq H$		-	≥ 12	-	≥ 100	≥ 40		
		$H_d > H$	Prohibited					

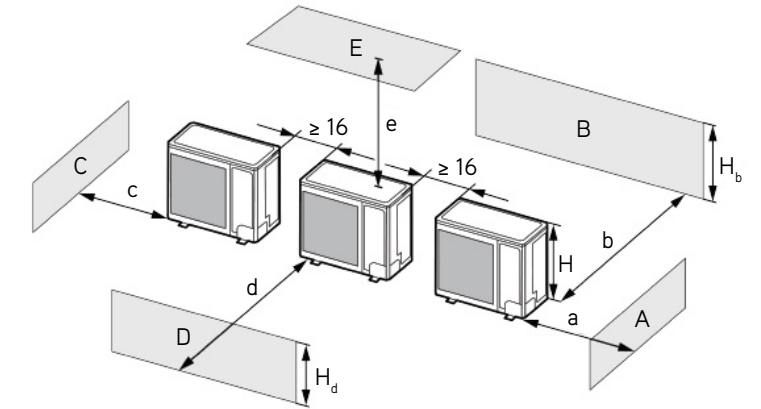

3. When outdoor units are installed in rows.

H_b, H_d	(in)
$H_b \leq 1/2H$	$b \leq 10$
$1/2H < H_b \leq H$	$b \leq 12$
$H_b > H$	Prohibited

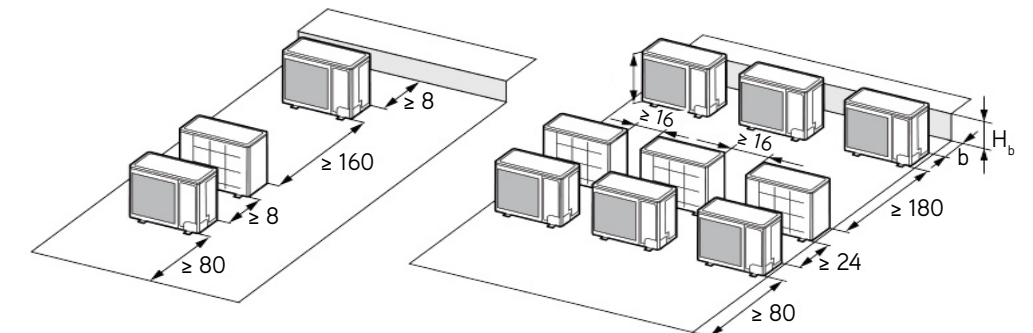

4. When outdoor units are installed one above another.

