




SUBMITTAL DATA

FXU24HP230V1R32AH / FXU24HP230V1R32AO
24000 BTU/H Unitary Heat Pump Split System

| | | |
|------------------|--------------|------|
| Job Name | Location | Date |
| Purchaser | Engineer | |
| Submitted to | For | |
| Unit Designation | Schedule No. | |

| | | |
|---|---|---|
|  |  |  |
| FXU24HP230V1R32AH | FXU24HP230V1R32AO | WK-010WC1 |

GENERAL FEATURES


- AHRI Certificate: [215213329](#)
- High Efficiency DC Inverter Technology
- 24VAC Thermostat Compatible
- Zero Lot Line Design
- Match with GREE or Competitive Indoor Unit
- New R32 Refrigerant
- WK-010WC1 Programmable Wired Controller Included
- Designed for New Construction or Replacement Market
- Low Ambient Cooling down to -15°C (5°F)
- Low Ambient Heating down to -30°C (-22°F)
- Coil (Outdoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Gold Colored Fin - 1500Hr Salt Spray Rating)
- Coil (Indoor) Copper Tube/Aluminum Fin with Anti-Corrosion Coil Coating (Blue Colored Fin - 500Hr Salt Spray Rating)

SPECIFICATIONS, FEATURES & FUNCTION SUMMARY

| SYSTEM TYPE | | |
|---|---|------------------------------|
| Outdoor Model | | FXU24HP230V1R32AO |
| Indoor Model | | FXU24HP230V1R32AH |
| SYSTEM PERFORMANCE§ | | |
| Cooling Capacity | Min - Max | Btu/h 17,952 - 26,400 |
| | Capacity @95°F | Btu/h 24,000 |
| Heating Capacity | Min - Max | Btu/h 17,287 - 27,000 |
| | Capacity @47°F | Btu/h 25,000 |
| | Capacity @17°F | Btu/h 20,600 |
| | Capacity @5°F | Btu/h 25,000 |
| SEER2 | | 18.0 |
| EER2 | | 12.5 |
| HSPF2 | | 10.0 |
| COP @5°F | | 2.0 |
| Cooling Temperature Range | | °F 5 - 129 |
| Heating Temperature Range | | °F -22 - 75 |
| Refrigerant Type | | R32 |
| INDOOR UNIT | | FXU24HP230V1R32AH |
| Power Supply | VAC | 208-230V / 1Ph / 60 Hz |
| Sound Pressure Level | dB(A) | 50 |
| Control Voltage | VAC | 24 |
| MOCP | A | 15 |
| MCA | A | 4.7 |
| Electric Heater (Optional) | kW | 5, 6, 10 |
| Air Flow | CFM | 760 |
| External Static Pressure (Up to) | In W.c. | 1.0 |
| Dehumidification | pt/hr | 4.25 |
| External Dimensions (W x H x D) | in | 18-1/8 x 43-1/2 x 21-1/4 |
| Package Dimension (W x H x D) | in | 20-5/8 x 45-5/8 x 26 |
| Net Weight | lbs | 135.6 |
| Gross Weight | lbs | 144.4 |
| OUTDOOR UNIT | | FXU24HP230V1R32AO |
| Power Supply | VAC | 208-230V / 1Ph / 60 Hz |
| Sound Pressure Level | dB(A) | 60 |
| Control Voltage | VAC | 24 |
| Rated Current Cooling | A | 14.6 |
| Rated Current Heating | A | 19.2 |
| MOCP | A | 25 |
| MCA | A | 21 |
| Compressor Type | GREE G20 / Double Cylinder / 2 - Stage Inverter | |
| External Dimensions (W x H x D) | in | 39 x 37-13/16 x 14-9/16 |
| Package Dimension (W x H x D) | in | 45-3/8 x 43-11/16 x 18-13/16 |
| Net Weight | lbs | 187.4 |
| Gross Weight | lbs | 211.6 |
| Refrigerant Charge - R32 | oz | 88.2 |
| Additional Charge | oz/ft | 0.323 |
| REFRIGERANT PIPING | | |
| Line Set Size (Liquid - Gas) - Flared Connections | in | 3/8 - 3/4 |
| Pre-Charge Length | ft | 31 |
| Pipe Length (Min - Max) | ft | 10 - 164 |
| Max. Pipe Elevation | ft | 49 |

| FEATURES & FUNCTIONS SUMMARY | |
|--|-------------------|
| Ultra Low Frequency Torque Control | Yes |
| Power Factor Correction | Yes |
| Outdoor Electronic Expansion Valve (EEV) | Yes |
| Indoor TXV Control | Yes |
| Basepan With Electric Heater | Yes |
| Compressor With Electric Heater | Yes |
| Fin Coating (Outdoor - Golden & Indoor - Blue) | Acrylic Resin |
| Intelligent Defrosting | Yes |
| Intelligent Preheating | Yes |
| Low Voltage Startup | Yes |
| Memory/Power Failure Recovery | Yes |
| Self Diagnosis | Yes |
| Low Ambient Cooling | Yes |
| 24VAC Thermostat Compatible | Yes |
| Indoor Fan Type | Centrifugal |
| Multi Fan Speeds | 5 Speeds |
| Auxiliary Electrical Heater | Optional |
| A2L Leak Detection Sensor (Indoor) | Factory Installed |

FAN PERFORMANCE

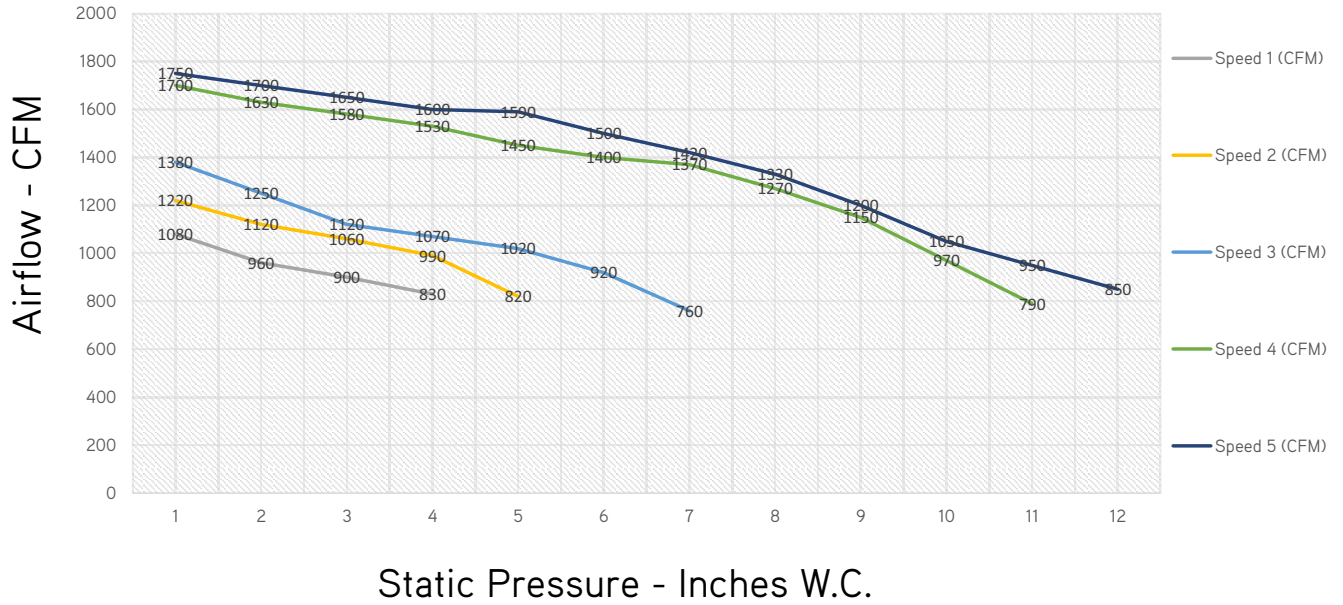

| STATIC PRESSURE Inches W.C. | 0 | 0.1 | 0.15 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 |
|-----------------------------|------|------|------|------|------|------|------|------|------|------|-----|-----|
| Speed 1 - CFM | 1080 | 960 | 900 | 830 | | | | | | | | |
| Speed 2 - CFM | 1220 | 1120 | 1060 | 990 | 820 | | | | | | | |
| Speed 3 - CFM | 1380 | 1250 | 1120 | 1070 | 1020 | 920 | 760 | | | | | |
| Speed 4 - CFM | 1700 | 1630 | 1580 | 1530 | 1450 | 1400 | 1370 | 1270 | 1150 | 970 | 790 | |
| Speed 5 - CFM | 1750 | 1700 | 1650 | 1600 | 1590 | 1500 | 1420 | 1330 | 1200 | 1050 | 950 | 850 |

NOTE:


1. Above chart CFM ratings are based on dry coil with factory filter installed.
2. For wet coil CFM ratings, multiply the CFM by 0.96 correction factor.

DIMENSIONS

INDOOR UNIT

Unit: inch


| FXU24HP230V1R32AH | |
|-------------------|--------|
| DIMENSIONS | |
| A | 11-5/8 |
| B | 16-3/4 |
| H | 43-1/2 |
| W | 18-1/8 |
| D | 21-1/4 |

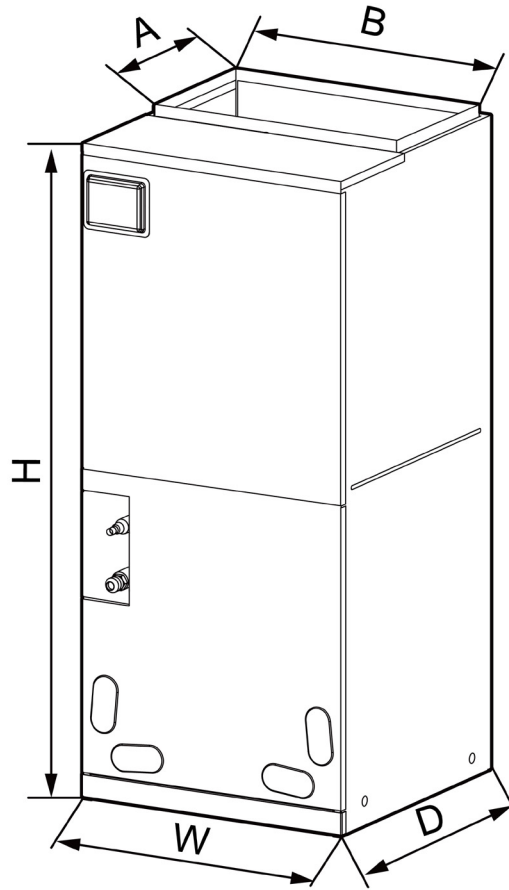


OUTDOOR UNIT

Unit: inch

| FXU24HP230V1R32AO | |
|-------------------|----------|
| DIMENSIONS | |
| A | 39 |
| B | 16-13/16 |
| C | 37-13/16 |
| D | 29-3/4 |
| E | 15-9/16 |
| F | 14-9/16 |

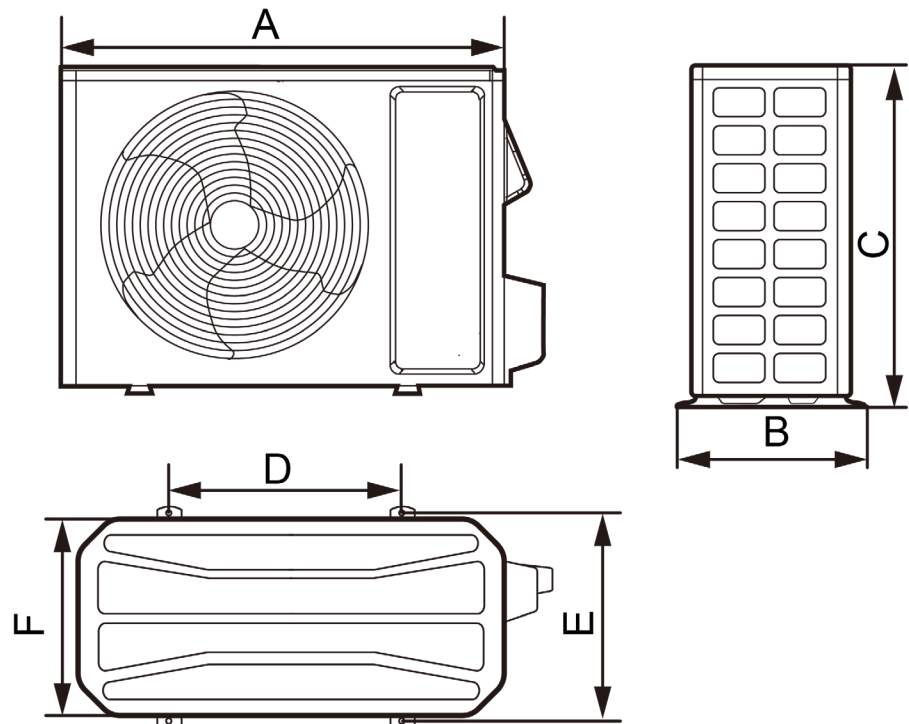

ACCESSORY HEATER AND GENERAL INFORMATION

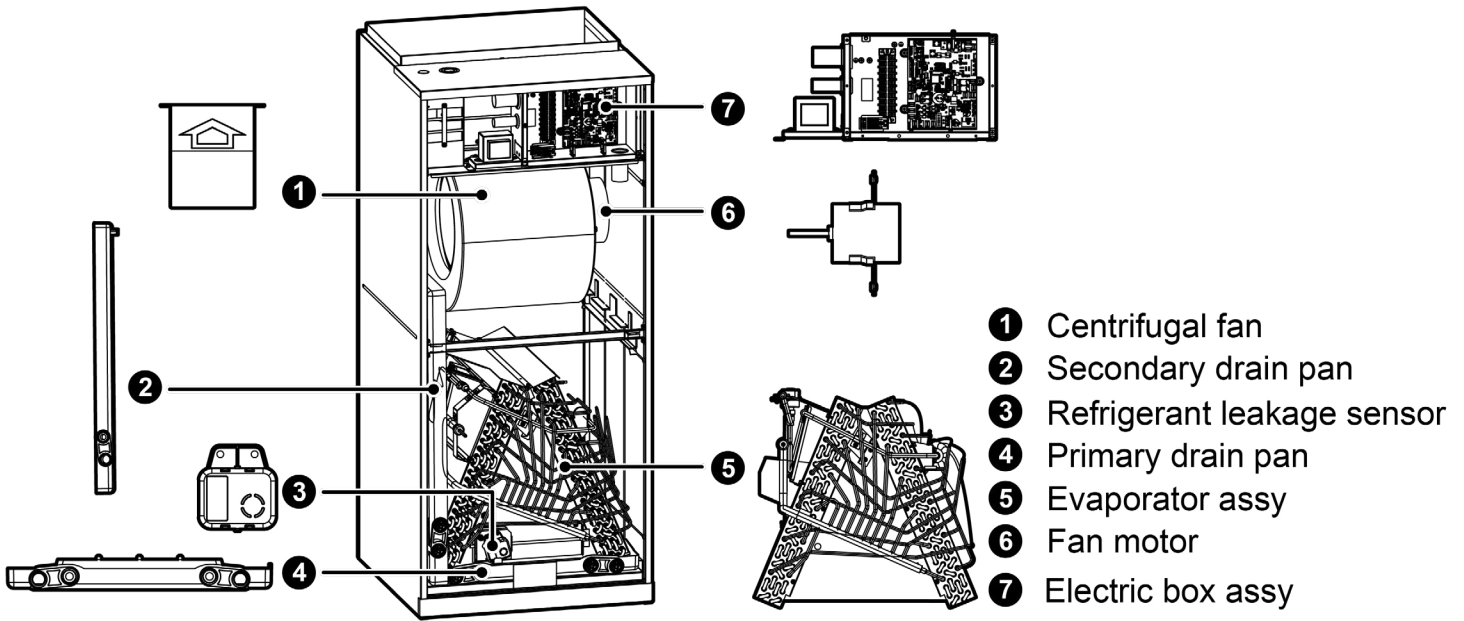

| MODEL | Heat Kit Model | Part Number | Electric Heat (kW) | | Min. Circuit Ampacity (A) | | Max Fuse or Breaker (A) | |
|-------------------|----------------|-----------------|--------------------|------|---------------------------|------|-------------------------|------|
| | | | 208V | 230V | 208V | 230V | 208V | 230V |
| FXU24HP230V1R32AH | 320004060249 | FLEXA2LHTR05KWD | 3.74 | 4.6 | 28 | 29.9 | 30 | 35 |
| | 320004060250 | FLEXA2LHTR10KWD | 7.49 | 9.2 | 50 | 55 | 60 | 60 |



| MODEL | Heat Kit Model | Part Number | Electric Heat (kW) | | Min. Circuit Ampacity (A) | | Max Fuse or Breaker (A) | |
|-------------------|----------------|--------------|--------------------|------|---------------------------|------|-------------------------|------|
| | | | 208V | 230V | 208V | 230V | 208V | 230V |
| FXU24HP230V1R32AH | 320004060223 | FLEXA2LHTR06 | 4.5 | 5.5 | 32 | 34.5 | 35 | 35 |

CLEARANCES


INDOOR UNIT

Minimum clearance

FRONT > 24

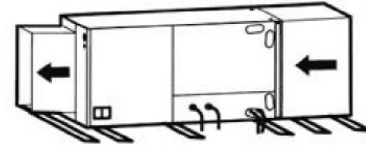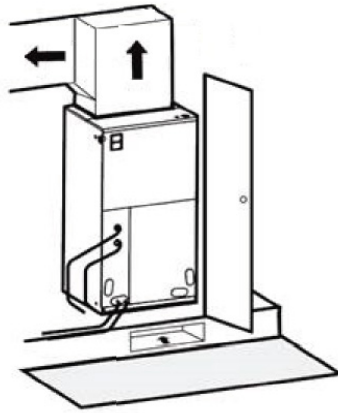

Horizontal Left Configuration - No Modification Needed

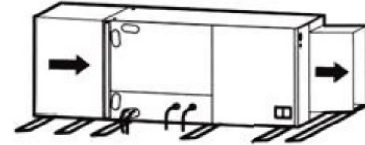

Horizontal Right Configuration - Must Relocate Drain Pan

NOTE:

Allow a minimum of 24" in front of the unit for service clearance. When installing in an area directly over a finished ceiling (such as an attic), an emergency drain pan is required directly under the unit. **See local and state codes for requirements.** When installing this unit in an area that may become wet, elevate the unit with a sturdy, non-porous material. In installations that may lead to physical damage (i.e. a garage) it is advised to install a protective barrier to prevent such damage. This air handler is designed for a complete supply and return ductwork system.

OUTDOOR UNIT


Minimum clearance

NOTE:

Install the Outdoor Unit **2 Inches** Above the Expected Snow Line

1. When one outdoor unit is to be installed.


| A - E | H_b H_d H | | (in) | | | | |
|------------|---------------|---------------------|------------|-----------|----------|-----------|-----------|
| | | | a | b | c | d | e |
| B | - | - | - | ≥ 4 | - | - | - |
| A, B, C | - | - | ≥ 12 | ≥ 4 | ≥ 4 | - | - |
| B, E | - | - | - | ≥ 4 | - | - | ≥ 40 |
| A, B, C, E | - | - | ≥ 12 | ≥ 6 | ≥ 6 | - | ≥ 40 |
| D | - | - | - | - | - | ≥ 40 | - |
| D, E | - | - | - | - | - | ≥ 40 | ≥ 40 |
| B, D | $H_b < H_d$ | $H_d < H$ | - | ≥ 4 | - | ≥ 40 | - |
| | $H_b > H_d$ | $H_d > H$ | - | ≥ 4 | - | ≥ 40 | - |
| B, D, E | - | $H_b \leq 1/2H$ | - | ≥ 10 | - | ≥ 80 | ≥ 40 |
| | $H_b < H_d$ | $1/2H < H_b \leq H$ | - | ≥ 10 | - | ≥ 80 | ≥ 40 |
| | - | $H_b > H$ | Prohibited | | | | |
| | $H_b > H_d$ | $H_d \leq 1/2H$ | - | ≥ 4 | - | ≥ 80 | ≥ 40 |
| | $H_b > H_d$ | $1/2H < H_d \leq H$ | - | ≥ 8 | - | ≥ 80 | ≥ 40 |
| - | $H_d > H$ | Prohibited | | | | | |

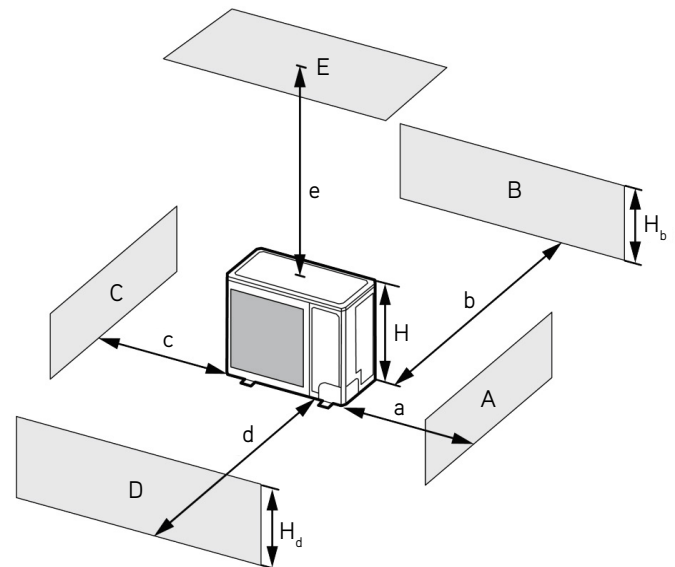

CLEARANCES


2. When two or more outdoor units are to be installed side by side.

| A - E | H_b H_d H | | (in) | | | | |
|------------|-----------------|---------------------|------------|-----------|-----------|------------|-----------|
| | | | a | b | c | d | e |
| A, B, C | - | - | ≥ 12 | ≥ 12 | ≥ 40 | - | - |
| A, B, C, E | - | - | ≥ 12 | ≥ 12 | ≥ 40 | - | ≥ 40 |
| D | - | - | - | - | - | ≥ 80 | - |
| D, E | - | - | - | - | - | ≥ 80 | ≥ 40 |
| B, D | $H_b < H_d$ | $H_d > H$ | - | ≥ 12 | - | ≥ 80 | - |
| | $H_b > H_d$ | $H_d \leq 1/2H$ | - | ≥ 10 | - | ≥ 80 | - |
| B, D, E | $H_b > H_d$ | $1/2H < H_b \leq H$ | - | ≥ 12 | - | ≥ 100 | - |
| | | $H_b \leq 1/2H$ | - | ≥ 12 | - | ≥ 80 | ≥ 40 |
| | $H_b < H_d$ | $1/2H < H_b \leq H$ | - | ≥ 12 | - | ≥ 100 | ≥ 40 |
| | | $H_b > H$ | Prohibited | | | | |
| | $H_b > H_d$ | $H_d \leq 1/2H$ | - | ≥ 10 | - | ≥ 100 | ≥ 40 |
| | | $1/2H < H_d \leq H$ | - | ≥ 12 | - | ≥ 100 | ≥ 40 |
| | $H_d > H$ | Prohibited | | | | | |

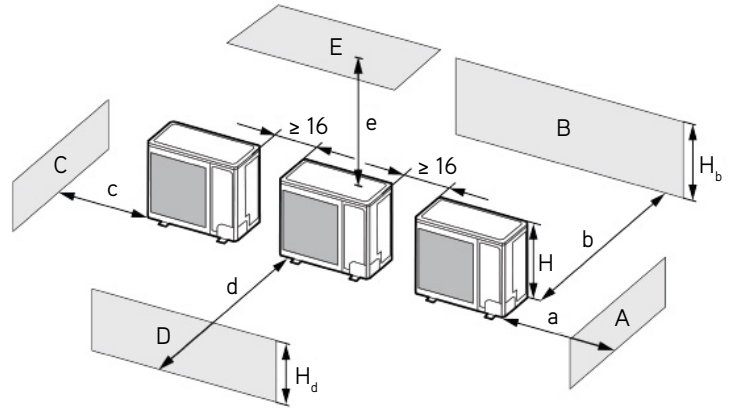


3. When outdoor units are installed in rows.

| H_b H_d | (in) |
|---------------------|-------------|
| $H_b \leq 1/2H$ | $b \leq 10$ |
| $1/2H < H_b \leq H$ | $b \leq 12$ |
| $H_b > H_d$ | Prohibited |

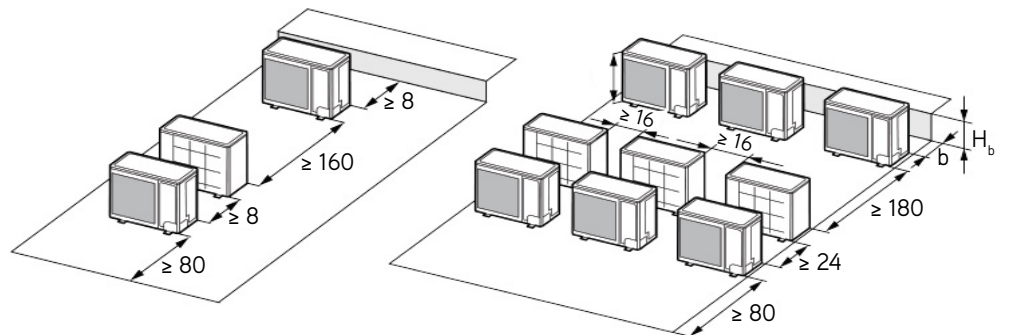

4. When outdoor units are installed one above another.

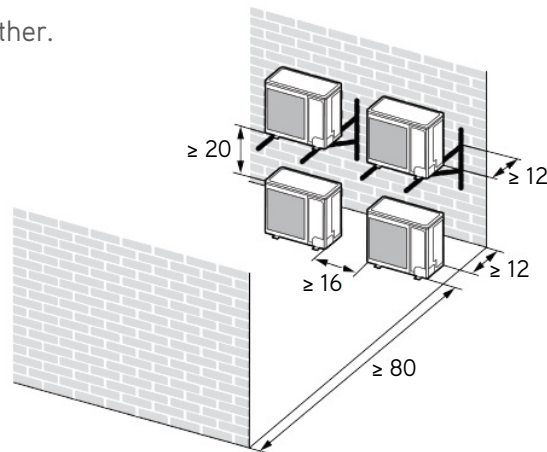

Specifications are subject to change without notice. Manufacturer reserves the right to discontinue or modify specifications or designs without notice or without incurring obligations. All Rights reserved.